


UNI-SPRAY SYSTEMS INC.

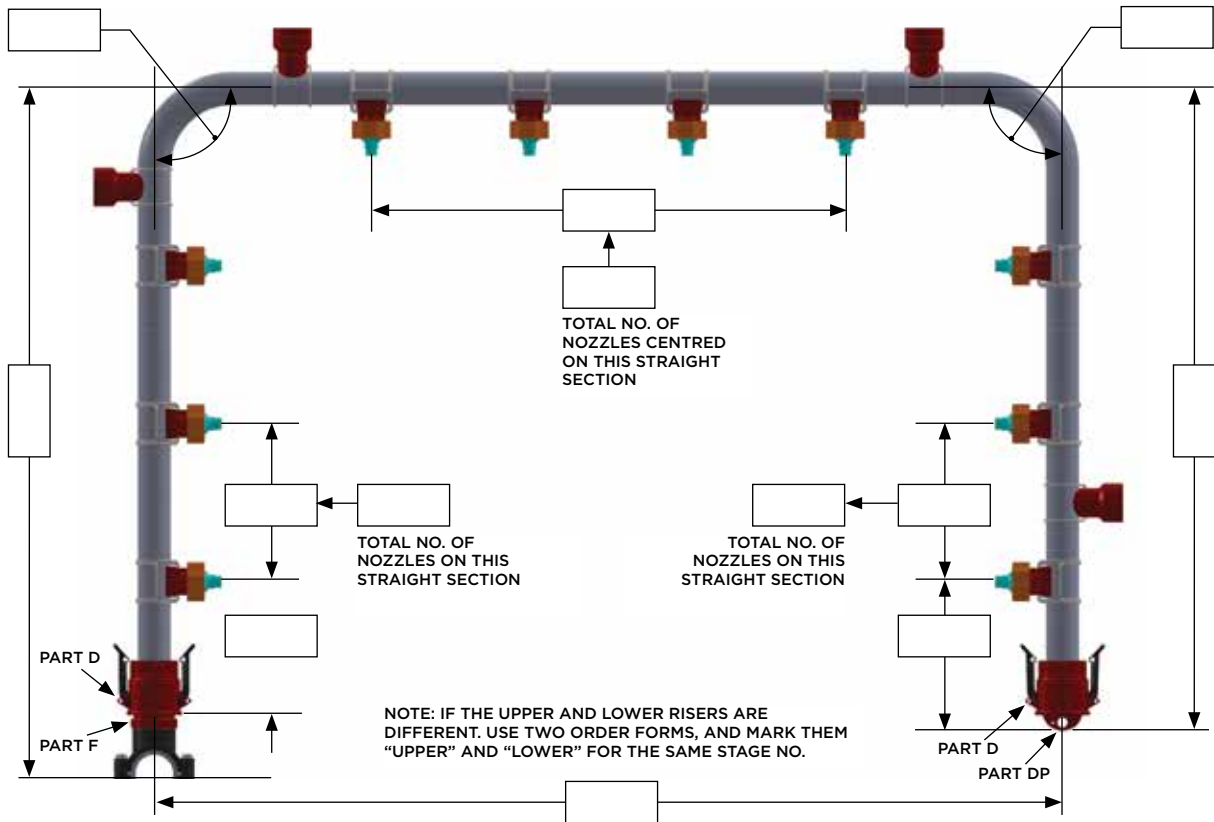

GENERAL INFO

STAGE NO: _____

TANK SIZE (LxWxH): _____

TANK CAPACITY; USG □: L □: _____

PUMP CAPACITY: _____

OPERATING PRESSURE: _____

HEADER SIZE: _____

TOTAL NO. OF RISERS PER STAGE: _____

RISER INFO

RISER PIPE SIZE: _____

NOZZLE ASS'Y PART NO: _____


TOTAL NO. OF NOZ'S PER RISER: _____

NO. OF RISER SUPPORTS PER RISER: _____

TOTAL NO. OF RISERS OF THIS TYPE FOR THIS ORDER INCLUDING SPARES: _____

DATE (M,D,Y): _____

NOTES: _____

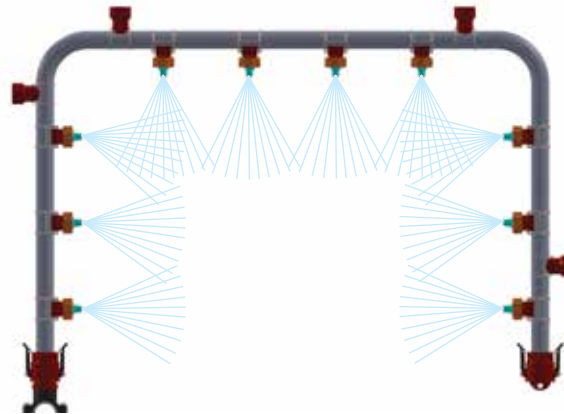

NOTE: THIS RISER CONFIGURATION AS SHOWN CONSISTS OF (2) IDENTICAL RISER SECTIONS, SHARING A SIDE-CENTRALLY LOCATED HEADER. (ONLY ONE RISER IS SHOWN FOR CLARITY.)

THE COMPLETE PAIR, TOP & BOTTOM, WOULD REQUIRE A QUANTITY OF (2) ON THE RISER ORDER. NOZZLE AND RISER SUPPORT QUANTITIES SHOULD BE FOR JUST ONE RISER.

RISER WORKSHEET

R15C

CUSTOMER: _____

ADDRESS: _____

CONTACT: _____

PHONE: _____

FAX: _____

Uni-Spray
Systems Inc.

CORPORATE OFFICE:
44 Durward Place,
Waterloo, Ontario,
Canada N2L 4E4
Tel: (519) 885-4270
Fax: (519) 885-4325

© Uni-Spray Systems Inc.